

IDFG MAGIC VALLEY REGIONAL OFFICE (PWS 5270030)
SOURCE WATER ASSESSMENT FINAL REPORT

January 20, 2006



State of Idaho
Department of Environmental Quality

Disclaimer: This publication has been developed as part of an informational service for the source water assessments of public water systems in Idaho and is based on data available at the time and the professional judgement of the staff. Although reasonable efforts have been made to present accurate information, no guarantees, including expressed or implied warranties of any kind, are made with respect to this publication by the State of Idaho or any of its agencies, employees, or agents, who also assume no legal responsibility for the accuracy of presentations, comments, or other information in this publication. The assessment is subject to modification if new data is produced.

Executive Summary

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative sensitivity to contaminants regulated by the Act. This assessment is based on a land use inventory of the designated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

This report, *Source Water Assessment for IDFG Magic Valley Regional Office, Jerome, Idaho*, describes the public drinking water system, the boundaries of the zones of water contribution, and the associated potential contaminant sources located within these boundaries. This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. **The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The IDFG Magic Valley Regional Office (PWS #5270030) drinking water system currently consists of two ground water wells. The system serves approximately 33 people through 1 connection.

Final susceptibility scores are derived from equally weighting system construction scores, hydrologic sensitivity scores, and potential contaminant/land use scores. Therefore, a low rating in one or two categories coupled with a higher rating in other category(ies) results in a final rating of low, moderate, or high susceptibility. With the potential contaminants associated with most urban and intensive agricultural areas, the best score a well can get is moderate. Potential contaminants are divided into four categories, inorganic contaminants (IOCs, e.g. nitrates, arsenic), volatile organic contaminants (VOCs, e.g. petroleum products), synthetic organic contaminants (SOCs, e.g. pesticides), and microbial contaminants (e.g. bacteria). As different wells can be subject to various contamination settings, separate scores are given for each type of contaminant.

In terms of total susceptibility, both Drinking Well and Fire Well received the same scores. Both wells rated high susceptibility for IOCs, VOCs, SOCs, and microbial bacteria. System construction rated moderate susceptibility and hydrologic sensitivity rated high susceptibility for the well. Land use rated moderate susceptibility for IOCs, VOCs, SOCs, and high susceptibility for microbial bacteria (Table 1)

At the time of this report, only the initial round of required water testing had been conducted for this new public water system. Test results indicated no microbial bacteria, VOCs, or SOCs, and IOCs below or near detection limits. The delineation exists within a county with high nitrogen fertilizer use, high herbicide use, and high agricultural chemical use.

This assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources. If the system should need to expand in the future, new well sites should be located in areas with as few potential sources of contamination as possible, and the site should be reserved and protected for this specific use.

For the IDFG Magic Valley Regional Office, drinking water protection activities should first focus on correcting any deficiencies outlined in the sanitary survey (an inspection conducted every five years with the purpose of determining the physical condition of a water system's components and its capacity). Actions should be taken to maintain a 50-foot radius circle around the wellhead clear of potential contaminants. Any contaminant spills within the delineation should be carefully monitored and dealt with. As much of the designated assessment areas are outside the direct jurisdiction of IDFG Magic Valley Regional Office, collaboration and partnerships with state and local agencies should be established and are critical to success.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A strong public education program should be a primary focus of any drinking water protection plan as the delineation contains some urban and residential land uses. Public education topics could include proper lawn and garden care practices, household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA. Drinking water protection activities for agriculture should be coordinated with the Idaho State Department of Agriculture, the Soil Conservation Commission, the local Soil and Water Conservation District, and the Natural Resources Conservation Service.

A community must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Twin Falls Regional Office of the Department of Environmental Quality or the Idaho Rural Water Association.

SOURCE WATER ASSESSMENT FOR IDFG MAGIC VALLEY REGIONAL OFFICE, TWIN FALLS, IDAHO

Section 1. Introduction - Basis for Assessment

The following sections contain information necessary to understand how and why this assessment was conducted. **It is important to review this information to understand what the ranking of this assessment means.** Maps showing the delineated source water assessment area and the inventory of significant potential sources of contamination identified within that area are included. The list of significant potential contaminant source categories and their rankings used to develop the assessment also is included.

Background

Under the Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative susceptibility to contaminants regulated by the Safe Drinking Water Act. This assessment is based on a land use inventory of the delineated assessment area and sensitivity factors associated with the wells and aquifer characteristics.

Level of Accuracy and Purpose of the Assessment

The Idaho Department of Environmental Quality (DEQ) is required by the U.S. EPA to assess the over 2,900 public drinking water sources in Idaho for their relative susceptibility to contaminants regulated by the Safe Drinking Water Act. This assessment is based on a land use inventory of the delineated assessment area, sensitivity factors associated with the wells, and aquifer characteristics. All assessments for sources active prior to 1999 were completed by May of 2003. Source water assessments for sources activated post-1999 are being developed on a case-by-case basis. The resources and time available to accomplish assessments are limited. An in-depth, site-specific investigation of each significant potential source of contamination is not possible. **Therefore, this assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this source. The results should not be used as an absolute measure of risk and they should not be used to undermine public confidence in the water system.**

The ultimate goal of the assessment is to provide data to local communities to develop a protection strategy for their drinking water supply system. DEQ recognizes that pollution prevention activities generally require less time and money to implement than treatment of a public water supply system once it has been contaminated. DEQ encourages communities to balance resource protection with economic growth and development. The decision as to the amount and types of information necessary to develop a drinking water protection program should be determined by the local community based on its own needs and limitations. Wellhead or drinking water protection is one facet of a comprehensive growth plan, and it can complement ongoing local planning efforts.

Section 2. Conducting the Assessment

General Description of the Source Water Quality

The IDFG Magic Valley Regional Office (PWS #5270030) drinking water system currently consists of two ground water wells. The system serves approximately 33 people through 1 connection.

At the time of this report, only the initial round of required water testing had been conducted for this new public water system. Test results indicated no microbial bacteria, VOCs, or SOC, and IOC below or near detection limits. The delineation exists within a county with high nitrogen fertilizer use, high herbicide use, and high agricultural chemical use.

Defining the Zones of Contribution – Delineation

The delineation process establishes the physical area around a well that will become the focal point of the assessment. The process includes mapping the boundaries of the zone of contribution into time-of-travel (TOT) zones (zones indicating the number of years necessary for a particle of water to reach a well) for water in the aquifer. DEQ performed the delineation using a computer model approved by the EPA in determining the 3-year (Zone 1B), 6-year (Zone 2), and 10-year (Zone 3) TOT for water associated with the Snake River Plain aquifer in the vicinity of the IDFG Magic Valley Regional Office. The computer model used site-specific data from a variety of sources including local area well logs, and hydrogeologic reports (detailed below).

Hydrogeology

The general direction of ground water flow is from the northeast to the southwest where the ground water discharges in springs and seeps to the Snake River. The largest collection of spring discharge is in the Thousand Springs area west of Jerome.

The eastern snake river plain (ESRP) is a northeast trending basin located in southeastern Idaho. The 10,000 square miles of the plain are filled primarily with highly fractured layered Quaternary basalt flows of the Snake River Group, which are intercalated with sedimentary rocks along the margins (Garabedian, 1992, p. 5). Individual basalt flows range from 10 to 50 feet thick, averaging 20 to 25 feet thick (Lindholm, 1996, p. 14). Basalt is thickest in the central part of the eastern plain and thins toward the margins. Whitehead (1992, p. 9) estimates the total thickness of the flows to be as great as 5,000 feet. A thin layer (0 to 100 feet) of windblown and fluvial sediments overlies the basalt.

The layered basalts of the Snake River Group host one of the most productive aquifers in the United States. The aquifer is generally considered unconfined, yet may be confined locally because of interbedded clay and dense unfractured basalt (Whitehead, 1992, p. 26). Whitehead (1992, p. 22) reports that well yields of 2,000 to 3,000 gal/min are common for wells open to less than 100 feet of the aquifer. Lindholm (1996, p. 18) estimates aquifer thickness to range from 100 feet near the plain's margin to thousands of feet near the center. Models of the regional aquifer have used values ranging from 200 to 3,000 feet to represent aquifer thickness (Cosgrove et al., 1999, p. 15).

Regional ground water flow is to the southwest paralleling the basin (Cosgrove et al., 1999; deSonneville, 1972, p. 78; Garabedian, 1992, p. 48; and Lindholm, 1996, p. 23). Reported water table gradients range from 3 to 100 ft/mile and average 12 ft/mile (Lindholm, 1996, p. 22). Gradients steepen at the plain's margin and at discharge locations.

The majority of aquifer recharge results from surface water irrigation activities (incidental recharge), which divert water from the Snake River and its tributaries (Ackerman, 1995, p. 4, and Garabedian, 1992, p. 11). Natural recharge occurs through stream losses, direct precipitation, and tributary basin underflow. The Southwest Margin of the ESRP hydrologic province is the regional aquifer's primary discharge area. Interpretation of well logs indicates that a 1- to 23-foot-thick layer of sediment overlies the fractured basalt aquifer in Jerome County, and that an 8- to 410-foot-thick layer of sediment overlies the same aquifer in southern Minidoka and Power Counties. Published geologic maps of the Snake River Plain (Whitehead 1992, Plates 1 and 5) indicate there is 100 to 500 feet of Quaternary to Tertiary Basalts aged compacted to poorly consolidated sediments located in the Heyburn area (north of the Snake River near Burley). The saturated thickness of the regional basalt aquifer for the Southwest Margin is estimated to range from less than 500 feet near the Snake River to 1,500 feet near Minidoka.

A published water table map of the Kimberly to Bliss region of the aquifer (Moreland, 1976, p. 5) indicates that the ground water flow direction in the Southwest Margin is similar to that depicted at the regional scale (e.g., Garabedian, 1992, Plate 4).


Annual average precipitation for the period 1951 to 1980 is 9.6 inches in both Twin Falls and Burley (Kjelstrom, 1995, p. 3). The estimated recharge from precipitation in the Southwest Margin ranges from less than 0.5 inch to more than 2 in./yr (Garabedian, 1992, p. 20). Kjelstrom (1995, p. 13) reports an annual river loss of 110,000 acre-feet to the aquifer for the 34.8-mile Minidoka-to-Milner reach of the Snake River. River gains of 210,000 acre-feet for the 21.5-mile Milner-to-Kimberly reach, and 880,000 acre-feet for the 20.4-mile Kimberly-to-Buhl reach are reported for the same period.

Model Description

The WhAEM analytical model was used to delineate a capture zone for the wells. The choice of boundary conditions greatly affects the results of the modeling because the boundaries are so near the wells.

The model boundaries consist of a 3300 ft constant head boundary west of Jerome and a 4100 ft constant head boundary about 30 miles east. The model boundaries were based on the water table map for March, 1980 by Garabedian. Hydraulic conductivity values of 3000 ft/day and 4000 ft/day were assigned to three zones based on model calibrated values by Cosgrove, and Garabedian. The aquifer thickness was assumed to be 250 ft.

FIGURE 1 Site Vicinity Map of IDFG Magic Valley Regional Office

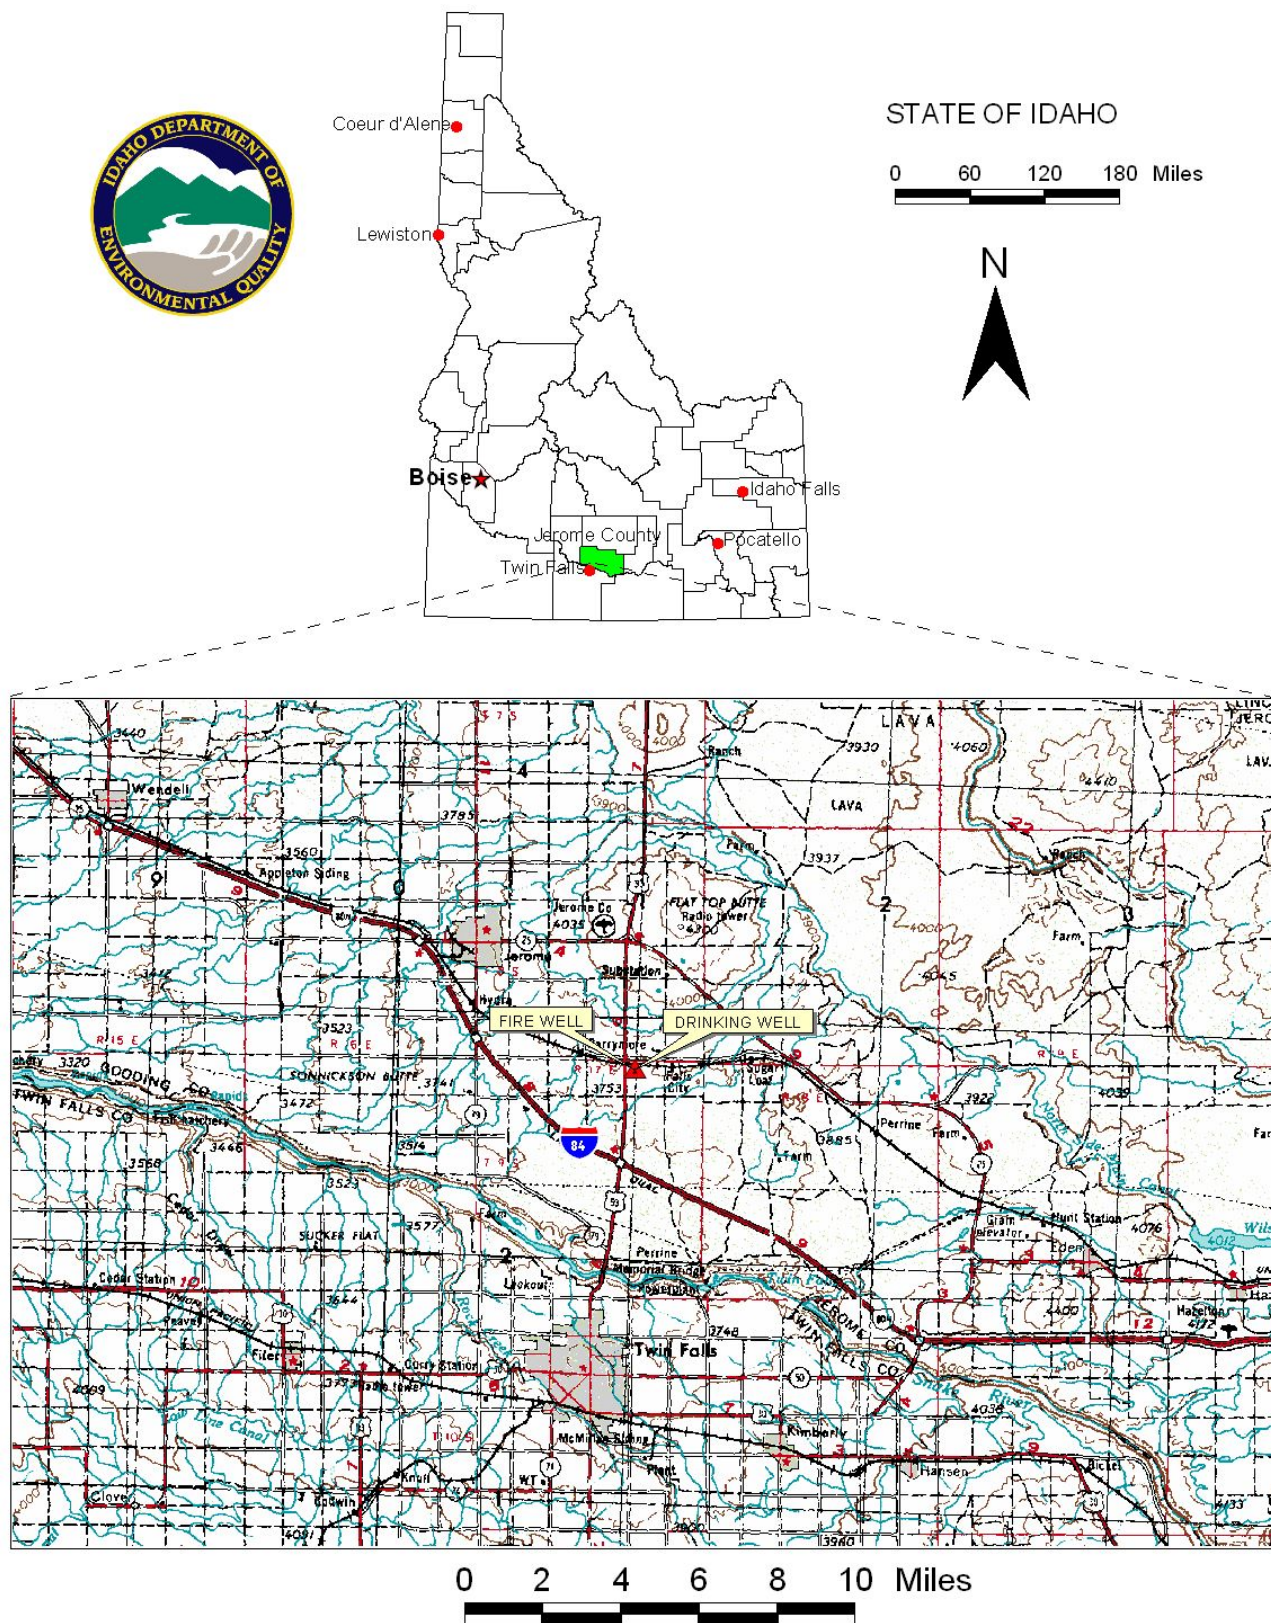

The delineated area for IDFG Magic Valley Regional Office Well #1 and #2 is an easterly trending sector approximately 17 miles long and 5 miles wide (Figure 2). The actual data used in determining the source water assessment delineation area is available from DEQ upon request.

Identifying Potential Sources of Contamination

A potential source of contamination is defined as any facility or activity that stores, uses, or produces, as a product or by-product, the contaminants regulated under the Safe Drinking Water Act and has a sufficient likelihood of releasing such contaminants at levels that could pose a concern relative to drinking water sources. The goal of the inventory process is to locate and describe those facilities, land uses, and environmental conditions that are potential sources of ground water contamination. The locations of potential sources of contamination within the delineation areas were obtained by field surveys conducted by DEQ and from available databases.

Land use within the area surrounding the IDFG Magic Valley Regional Office wells is predominately rangeland and basalt.

It is important to understand that a release may never occur from a potential source of contamination provided they are using best management practices. Many potential sources of contamination are regulated at the federal level, state level, or both to reduce the risk of release. Therefore, when a business, facility, or property is identified as a potential contaminant source, this should not be interpreted to mean that this business, facility, or property is in violation of any local, state, or federal environmental law or regulation. What it does mean is that the potential for contamination exists due to the nature of the business, industry, or operation. There are a number of methods that water systems can use to work cooperatively with potential sources of contamination, including educational visits and inspections of stored materials. Many owners of such facilities may not even be aware that they are located near a public water supply well.

Contaminant Source Inventory Process

A two-phased contaminant inventory of the study area was conducted in September and October 2005. The first phase involved identifying and documenting potential contaminant sources within the IDFG Magic Valley Regional Office source water assessment area (Figures 2) through the use of computer databases and Geographic Information System (GIS) maps developed by DEQ. The second, or enhanced, phase of the contaminant inventory involved contacting the operator to identify and add any additional potential sources in the delineated areas.

The delineated source water area contains 11 potential contaminant sources. The potential sources include a feed dealer, gravel pit, dairy, recharge wells, transportation corridors, and canals (Table 2).

Section 3. Susceptibility Analyses

The well's susceptibility to contamination was ranked as high, moderate, or low risk according to the following considerations: hydrologic characteristics, physical integrity of the well, land use characteristics, and potentially significant contaminant sources. The susceptibility rankings are specific to a particular potential contaminant or category of contaminants. Therefore, a high susceptibility rating relative to one potential contaminant does not mean that the water system is at the

same risk for all other potential contaminants. The relative ranking that is derived for each well is a qualitative, screening-level step that, in many cases, uses generalized assumptions and best professional judgement. Appendix A contains the susceptibility analysis worksheet. The following summaries describe the rationale for the susceptibility ranking.

Hydrologic Sensitivity

The hydrologic sensitivity of a well is dependent upon four factors: the surface soil composition, the material in the vadose zone (between the land surface and the water table), the depth to first ground water, and the presence of a 50-foot thick fine-grained zone (aquitard) above the producing zone of the well. Slowly draining soils such as silt and clay typically are more protective of ground water than coarse-grained soils such as sand and gravel. Similarly, fine-grained sediments in the subsurface and a water depth of more than 300 feet protect the ground water from contamination.

Both Drinking Well and Fire Well rated high susceptibility for hydrologic sensitivity. According to their well logs, each well's vadose zone is composed of predominantly permeable materials, neither well contains an aquitard above their producing zones, and both wells have water tables less than 300 feet below ground surface. Additionally, according to the Natural Resource Conservation Service (NRCS), area soils within the delineation are moderately- to well-drained.

Well Construction

Well construction directly affects the ability of the well to protect the aquifer from contaminants. System construction scores are reduced when information shows that potential contaminants will have a more difficult time reaching the intake of the well. Lower scores imply a system is less vulnerable to contamination. For example, if the well casing and annular seal both extend into a low permeability unit, then the possibility of contamination is reduced and the system construction score goes down. If the highest production interval is more than 100 feet below the water table, then the system is considered to have better buffering capacity. If the wellhead and surface seal are maintained to standards, as outlined in sanitary surveys, then contamination down the well bore is less likely. If the well is protected from surface flooding and is outside the 100-year floodplain, then contamination from surface events is reduced.

According to its well log, Drinking Well was drilled to a depth of 262 feet below ground surface (bgs) and perforations were cut from 222 feet bgs to 262 feet bgs. A 6-inch casing (0.288 inches thick) extends from the surface to 262 feet bgs into clay. The well was sealed with bentonite from the surface to 60 feet bgs. Besides topsoil, the only substrate encountered while drilling was basalt.

According to its well log, Fire Well was drilled to a depth of 310 feet bgs and has two perforated intervals between 137 feet bgs and 298 feet bgs. A 14-inch casing (0.25 inches thick) extends from the surface to 298 feet bgs into basalt. The well was sealed with bentonite from the surface to 37 feet bgs.

Both Drinking Well and Fire Well rated moderate susceptibility for system construction. Both wells are located outside of a 100-year floodplain. According to the sanitary survey, the wellheads and surface seals are maintained. The well log indicates that both the casing and annular seal do not extend into low-permeability units, and the highest production comes from less than 100 feet below static water levels.

Current PWS well construction standards can be more stringent than when a well(s) was constructed. The Idaho Department of Water Resources *Well Construction Standards Rules* (1993) require all PWSs to follow DEQ standards as well. IDAPA 58.01.08.550 requires that PWSs follow the *Recommended Standards for Water Works* (1997) during construction. Some of the regulations deal with screening requirements, aquifer pump tests, use of a down-turned casing vent, and thickness of casing. Table 1 of the *Recommended Standards for Water Works* (1997) lists the required steel casing thickness for various diameter wells.



Regulations for steel pipe thickness based on size of pipe

<u>Size of pipe (inches)</u>	<u>Thickness (inches)</u>
≤6	0.280
8	0.322
10	0.365
12-20	0.375

Well tests are required at the design pumping rate for 24 hours or until stabilized drawdown has continued for at least six hours when pumping at 1.5 times the design pumping rate.

Because neither well met all the current construction standards, each was assessed an additional system construction point.

Figure 2. IDFG Magic Valley Regional Office Delineation Map and Potential Contaminant Source Locations

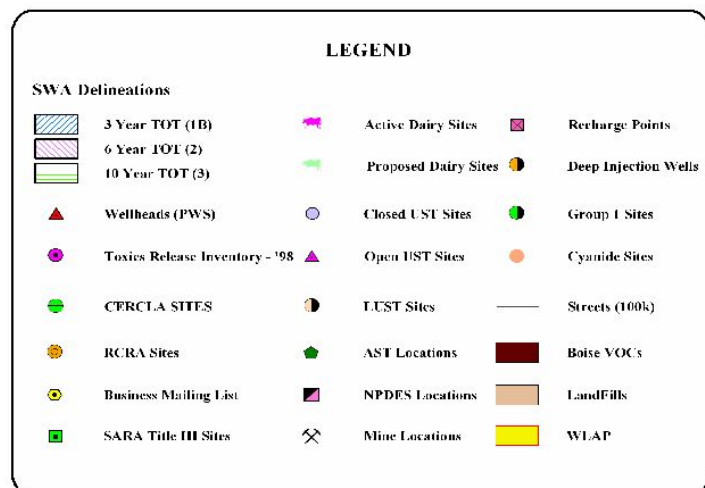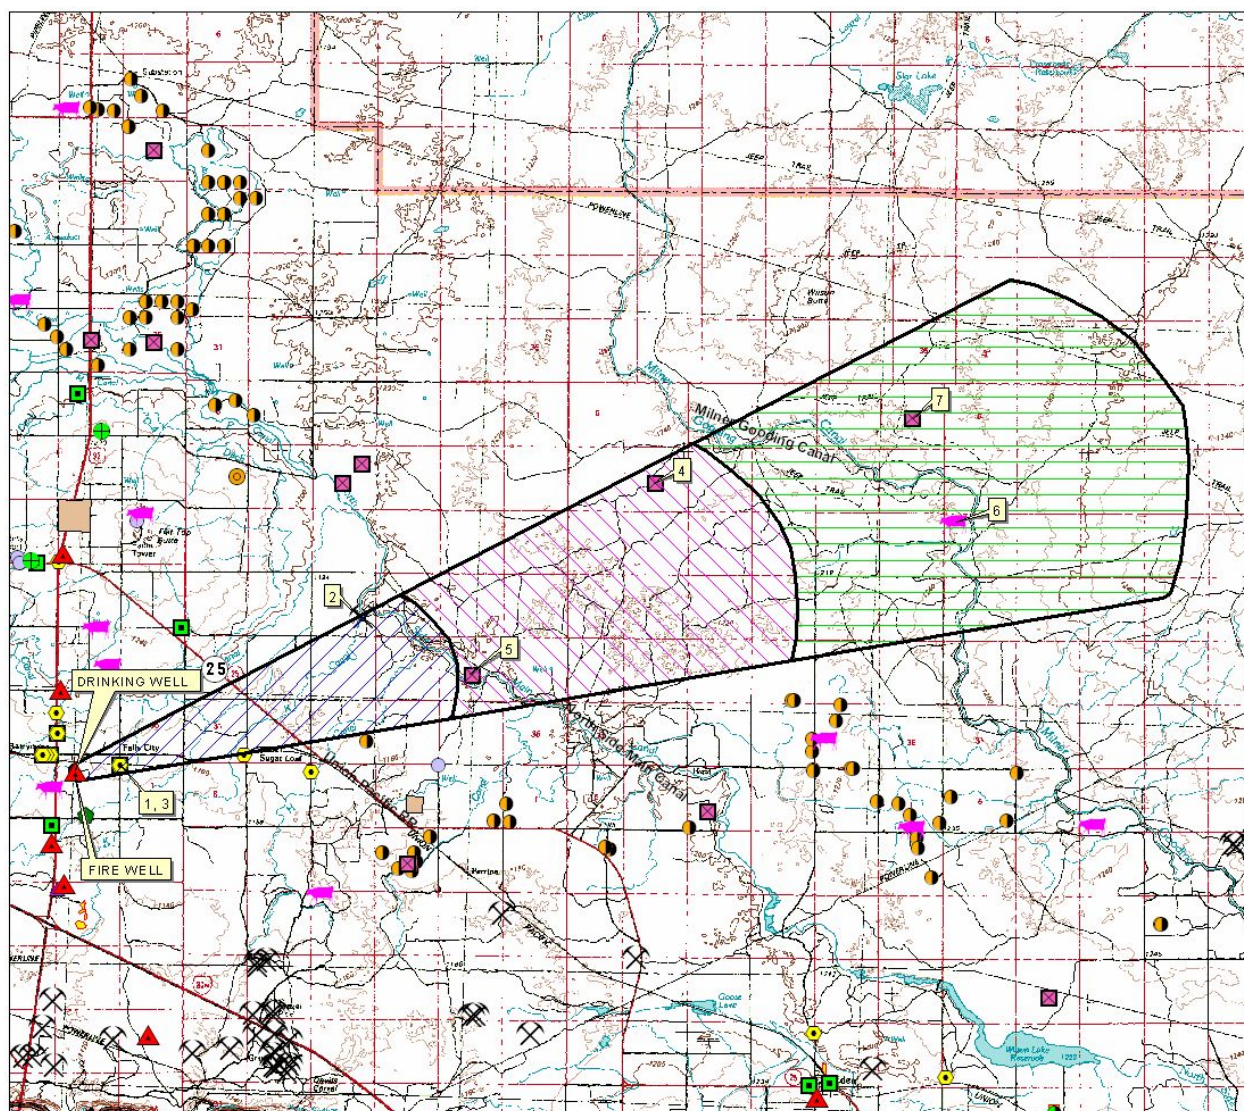

0 1 2 3 4 5 Miles



PWS# 5270030
Well

Potential Contaminant Sources and Land Use

Land use within Drinking Well and Fire Well's delineation rated moderate susceptibility for IOCs, VOCs, SOC, and high for microbial contaminants. The agriculture activity within the 0-3 TOT zone and identified potential contaminant sources in Figure 2 were the largest contributors to the scores.

Final Susceptibility Ranking

A detection above a drinking water standard MCL, any detection of a VOC or SOC, or a detection of total coliform bacteria or fecal coliform bacteria at the wellhead will automatically give a high susceptibility rating to a well despite the land use of the area because a pathway for contamination already exists. Additionally, potential contaminant sources within 50 feet of a wellhead will automatically lead to a high susceptibility rating. Hydrologic sensitivity and system construction scores are heavily weighted in the final scores. Having multiple potential contaminant sources in the 0 to 3-year time of travel zone (Zone 1B) contribute greatly to the overall ranking.

Table 1. Summary of IDFG Magic Valley Regional Office Susceptibility Evaluation

	Susceptibility Scores ¹									
	Hydrologic Sensitivity	Contaminant Inventory				System Construction	Final Susceptibility Ranking			
Well		IOC	VOC	SOC	Microbials		IOC	VOC	SOC	Microbials
Drinking Well	H	M	M	M	H	M	H	H	H	H
Fire Well	H	M	M	M	H	M	H	H	H	H

¹H = High Susceptibility, M = Moderate Susceptibility, L = Low Susceptibility,

IOC = inorganic chemical, VOC = volatile organic chemical, SOC = synthetic organic chemical

Susceptibility Summary

In terms of total susceptibility, both Drinking Well and Fire Well received the same scores. Both wells rated high susceptibility for IOCs, VOCs, SOC, and microbial bacteria. System construction rated moderate susceptibility and hydrologic sensitivity rated high susceptibility for the well. Land use rated moderate susceptibility for IOCs, VOCs, SOC, and high susceptibility for microbial bacteria (Table 1)

At the time of this report, only the initial round of required water testing had been conducted for this new public water system. Test results indicated no microbial bacteria, VOCs, or SOC, and IOCs below or near detection limits. The delineation exists within a county with high nitrogen fertilizer use, high herbicide use, and high agricultural chemical use.

Section 4. Options for Drinking Water Protection

The susceptibility assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what the susceptibility ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses that require surveillance, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

An effective drinking water protection program is tailored to the particular local drinking water protection area. A community with a fully developed drinking water protection program will incorporate many strategies. For IDFG Magic Valley Regional Office, drinking water protection activities should first focus on correcting any deficiencies outlined in the sanitary survey. Actions should be taken to keep a 50-foot radius circle clear around the wellheads. Any spills within the delineation should be carefully monitored and dealt with. As much of the designated protection area is outside the direct jurisdiction IDFG Magic Valley Regional Office, forming partnerships and collaborating with state and local agencies and industry groups are critical to the success of drinking water protection.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A public education program should be a primary focus of any drinking water protection plan as the delineation is near residential land uses areas. Public education topics could include proper household hazardous waste disposal methods, proper care and maintenance of septic systems, and the importance of water conservation to name but a few. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the EPA.

A community must incorporate a variety of strategies in order to develop a comprehensive drinking water protection plan, be they regulatory in nature (i.e. zoning, permitting) or non-regulatory in nature (i.e. good housekeeping, public education, specific best management practices). For assistance in developing protection strategies please contact the Twin Falls Regional Office of the DEQ or the Idaho Rural Water Association.

Assistance

Public water suppliers and others may call the following DEQ offices with questions about this assessment and to request assistance with developing and implementing a local protection plan. In addition, draft protection plans may be submitted to the DEQ office for preliminary review and comments.

Twin Falls Regional DEQ Office (208) 736-2190

State DEQ Office (208) 373-0502

Website: <http://www.state.id.us/deq>

Water suppliers serving fewer than 10,000 persons may contact Melinda Harper (mlharper@idahoruralwater.com), Idaho Rural Water Association, at 1-208-343-7001 for assistance with drinking water protection (formerly wellhead protection) strategies.

POTENTIAL CONTAMINANT INVENTORY

LIST OF ACRONYMS AND DEFINITIONS

AST (Aboveground Storage Tanks) – Sites with aboveground storage tanks.

Business Mailing List – This list contains potential contaminant sites identified through a yellow pages database search of standard industry codes (SIC).

CERCLIS – This includes sites considered for listing under the **Comprehensive Environmental Response Compensation and Liability Act (CERCLA)**. CERCLA, more commonly known as a Superfund, is designed to clean up hazardous waste sites that are on the national priority list (NPL).

Cyanide Site – DEQ permitted and known historical sites/facilities using cyanide.

Dairy – Sites included in the primary contaminant source inventory represent those facilities regulated by Idaho State Department of Agriculture (ISDA) and may range from a few head to several thousand head of milking cows.

Deep Injection Well – Injection wells regulated under the Idaho Department of Water Resources generally for the disposal of stormwater runoff or agricultural field drainage.

Enhanced Inventory – Enhanced inventory locations are potential contaminant source sites added by the water system. These can include new sites not captured during the primary contaminant inventory, or corrected locations for sites not properly located during the primary contaminant inventory. Enhanced inventory sites can also include miscellaneous sites added by the Idaho Department of Environmental Quality (DEQ) during the primary contaminant inventory.

Floodplain – This is a coverage of the 100-year floodplains.

Group 1 Sites – These are sites that show elevated levels of contaminants and are not within the priority one areas.

Inorganic Priority Area – Priority one areas where greater than 25% of the wells/springs show constituents higher than primary standards or other health standards.

Landfill – Areas of open and closed municipal and non-municipal landfills.

LUST (Leaking Underground Storage Tank) – Potential contaminant source sites associated with leaking underground storage tanks as regulated under RCRA.

Mines and Quarries – Mines and quarries permitted through the Idaho Department of Lands.)

Nitrate Priority Area – Area where greater than 25% of wells/springs show nitrate values above 5mg/l.

NPDES (National Pollutant Discharge Elimination System) – Sites with NPDES permits. The Clean Water Act requires that any discharge of a pollutant to waters of the United States from a point source must be authorized by an NPDES permit.

Organic Priority Areas – These are any areas where greater than 25 % of wells/springs show levels greater than 1% of the primary standard or other health standards.

Recharge Point – This includes active, proposed, and possible recharge sites on the Snake River Plain.

RICRIS – Site regulated under **Resource Conservation Recovery Act (RCRA)**. RCRA is commonly associated with the cradle to grave management approach for generation, storage, and disposal of hazardous wastes.

SARA Tier II (Superfund Amendments and Reauthorization Act Tier II Facilities) – These sites store certain types and amounts of hazardous materials and must be identified under the Community Right to Know Act.

Toxic Release Inventory (TRI) – The toxic release inventory list was developed as part of the Emergency Planning and Community Right to Know (Community Right to Know) Act passed in 1986. The Community Right to Know Act requires the reporting of any release of a chemical found on the TRI list.

UST (Underground Storage Tank) – Potential contaminant source sites associated with underground storage tanks regulated as regulated under RCRA.

Wastewater Land Applications Sites – These are areas where the land application of municipal or industrial wastewater is permitted by DEQ.

Wellheads – These are drinking water well locations regulated under the Safe Drinking Water Act. They are not treated as potential contaminant sources.

NOTE: Many of the potential contaminant sources were located using a geocoding program where mailing addresses are used to locate a facility. Field verification of potential contaminant sources is an important element of an enhanced inventory.

Where possible, a list of potential contaminant sites unable to be located with geocoding will be provided to water systems to determine if the potential contaminant sources are located within the source water assessment area.

References Cited

- Ackerman, D.J., 1995, *Analysis of Steady-State Flow and Advective Transport in the Eastern Snake River Plain Aquifer System, Idaho*, U.S. Geological Survey Water-Resources Investigations Report 94-4257, 25 p. I-FY95.
- Cosgrove, D.M., G.S. Johnson, S. Laney, and J. Lindgren, 1999, *Description of the IDWR/UI Snake River Plain Aquifer Model (SRPAM)*, Idaho Water Resources Research Institute, University of Idaho, 95 p.
- deSonneville, J.L.J., 1972, *Development of a Mathematical Ground water Model*, Water Resources Research Institute, University of Idaho, Moscow, Idaho, 227 p.
- Garabedian, S.P., 1992, *Hydrology and Digital Simulation of the Regional Aquifer System, Eastern Snake River Plain, Idaho*, U.S. Geological Survey Professional Paper 1408-F, 102 p., 10 pl. I-FY92.
- Great Lakes-Upper Mississippi River Board of State and Provincial Public Health and Environmental Managers, 1997. "Recommended Standards for Water Works."
- Idaho Department of Environmental Quality, 1997. Design Standards for Public Drinking Water Systems. IDAPA 58.01.08.550.01.
- Idaho Department of Water Administration. Well Driller's Report, Idaho Fish and Wildlife Association. 2005.
- Idaho Department of Water Resources, 1993. Administrative Rules of the Idaho Water Resource Board: Well Construction Standards Rules. IDAPA 37.03.09.
- Kjelstrom, L.C., 1995, *Streamflow Gains and Losses in the Snake River and Ground-Water Budgets for the Snake River Plain, Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-C, 47 p. I-FY95.
- Lindholm, G.F., 1996, *Summary of the Snake River Plain Regional Aquifer-System analysis in Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-A, 59 p.
- Moreland, J.A., 1976, *Digital-Model Analysis of the Effects of Water-Use Alternatives on Spring Discharges, Gooding and Jerome Counties, Idaho*, U.S. Geological Survey and Idaho Department of Water Resources, Water Information Bulletin No.42, 46p.
- Whitehead, R.L., 1992, *Geohydrologic Framework of the Snake River Plain Regional Aquifer System, Idaho and Eastern Oregon*, U.S. Geological Survey Professional Paper 1408-B, 32p. I-FY92

Appendix A

IDFG Magic Valley Regional Office Susceptibility Analysis Worksheets

The final scores for the susceptibility analysis were determined using the following formulas:

- 1) VOC/SOC/IOC Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.2)
- 2) Microbial Final Score = Hydrologic Sensitivity + System Construction + (Potential Contaminant/Land Use x 0.375)

Final Susceptibility Scoring:

0 - 5 Low Susceptibility

6 - 12 Moderate Susceptibility

≥ 13 High Susceptibility

1. System Construction		SCORE			
	Drill Date	2/22/2005			
	Driller Log Available	YES			
	Sanitary Survey (if yes, indicate date of last survey)	YES	2005		
	Well meets IDWR construction standards	NO	1		
	Wellhead and surface seal maintained	YES	0		
	Casing and annular seal extend to low permeability unit	NO	2		
	Highest production 100 feet below static water level	NO	1		
	Well located outside the 100 year flood plain	YES	0		
Total System Construction Score			4 (M)		
2. Hydrologic Sensitivity					
	Soils are poorly to moderately drained	NO	2		
	Vadose zone composed of gravel, fractured rock or unknown	YES	1		
	Depth to first water > 300 feet	NO	1		
	Aquitard present with > 50 feet cumulative thickness	NO	1		
Total Hydrologic Score			6(H)		
3. Potential Contaminant / Land Use - ZONE 1A		IOC Score	VOC Score	SOC Score	Microbial Score
	Land Use Zone 1A	RANGELAND/BASALT	0	0	0
	Farm chemical use high	YES	2	2	0
	IOC, VOC, SOC, or Microbial sources in Zone 1A	NO	NO	NO	NO
Total Potential Contaminant Source/Land Use Score - Zone 1A		2	0	2	0
Potential Contaminant / Land Use - ZONE 1B					
	Contaminant sources present (Number of Sources)	YES	6	5	6
	(Score = # Sources X 2) 8 Points Maximum		8	8	8
	Sources of Class II or III leacheable contaminants or	YES	2	2	2
	4 Points Maximum		2	2	2
	Zone 1B contains or intercepts a Group 1 Area	NO	0	0	0
	Land use Zone 1B	Greater Than 50% Agricultural Land	4	4	4
Total Potential Contaminant Source / Land Use Score - Zone 1B		14	14	14	12
Potential Contaminant / Land Use - ZONE II					
	Contaminant Sources Present	YES	2	2	2
	Sources of Class II or III leacheable contaminants or	YES	1	1	1
	Land Use Zone II	<25% Agricultural Land	0	0	0
Potential Contaminant Source / Land Use Score - Zone II		3	3	3	0
Potential Contaminant / Land Use - ZONE III					
	Contaminant Source Present	YES	1	1	1
	Sources of Class II or III leacheable contaminants or	YES	1	1	1
	Is there irrigated agricultural lands that occupy > 50% of	NO	0	0	0
Total Potential Contaminant Source / Land Use Score - Zone III		2	2	2	0
Cumulative Potential Contaminant / Land Use Score		22(M)	20(M)	22(M)	12(H)
4. Final Susceptibility Source Score		15	15	15	16
5. Final Well Ranking		High	High	High	High

1. System Construction		SCORE			
Drill Date	2/21/2005				
Driller Log Available	YES				
Sanitary Survey (if yes, indicate date of last survey)	YES	2005			
Well meets IDWR construction standards	NO	1			
Wellhead and surface seal maintained	YES	0			
Casing and annular seal extend to low permeability unit	NO	2			
Highest production 100 feet below static water level	NO	1			
Well located outside the 100 year flood plain	YES	0			
Total System Construction Score		4 (M)			
2. Hydrologic Sensitivity					
Soils are poorly to moderately drained	NO	2			
Vadose zone composed of gravel, fractured rock or unknown	YES	1			
Depth to first water > 300 feet	NO	1			
Aquitard present with > 50 feet cumulative thickness	NO	1			
Total Hydrologic Score		6(H)			
3. Potential Contaminant / Land Use - ZONE 1A		IOC Score	VOC Score	SOC Score	Microbial Score
Land Use Zone 1A	RANGELAND/BASALT	0	0	0	0
Farm chemical use high	YES	2	0	2	
IOC, VOC, SOC, or Microbial sources in Zone 1A	NO	NO	NO	NO	NO
Total Potential Contaminant Source/Land Use Score - Zone 1A		2	0	2	0
Potential Contaminant / Land Use - ZONE 1B					
Contaminant sources present (Number of Sources)	YES	6	5	6	4
(Score = # Sources X 2) 8 Points Maximum		8	8	8	8
Sources of Class II or III leacheable contaminants or	YES	2	2	2	
4 Points Maximum		2	2	2	
Zone 1B contains or intercepts a Group 1 Area	NO	0	0	0	0
Land use Zone 1B	Greater Than 50% Agricultural Land	4	4	4	4
Total Potential Contaminant Source / Land Use Score - Zone 1B		14	14	14	12
Potential Contaminant / Land Use - ZONE II					
Contaminant Sources Present	YES	2	2	2	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Land Use Zone II	<25% Agricultural Land	0	0	0	
Potential Contaminant Source / Land Use Score - Zone II		3	3	3	0
Potential Contaminant / Land Use - ZONE III					
Contaminant Source Present	YES	1	1	1	
Sources of Class II or III leacheable contaminants or	YES	1	1	1	
Is there irrigated agricultural lands that occupy > 50% of	NO	0	0	0	
Total Potential Contaminant Source / Land Use Score - Zone III		2	2	2	0
Cumulative Potential Contaminant / Land Use Score		22(M)	20(M)	22(M)	12(H)
4. Final Susceptibility Source Score		15	15	15	16
5. Final Well Ranking		High	High	High	High

Appendix B

Table 2 Potential Contaminant Inventory

Table 2. Potential Contaminant Inventory

SITE	Source Description ¹	TOT ² ZONE	Source of Information	Potential Contaminants ³
1	Feed Dealer, wholesale	0-3 YR	Database Search	IOC, SOC, Microbials
2	Gravel Pit	0-3 YR	Database Search	IOC, VOC, SOC, Microbials
3	Special Warehousing and Storage	0-3 YR	Database Search	IOC, VOC, SOC
4	Recharge Well	3-6 YR	Database Search	IOC, SOC
5	Recharge Well	3-6 YR	Database Search	IOC, SOC
6	Dairy (2000 cows)	6-10 YR	Database Search	IOC, SOC
7	Recharge Well	6-10 YR	Database Search	IOC, SOC
	North Side Main Canal	0-6 YR	GIS Map	IOC, VOC, SOC, Microbials
	Milner Gooding Canal	6-10 YR	GIS Map	IOC, VOC, SOC
	Highway 25	0-3 YR	GIS Map	IOC, VOC, SOC, Microbials
	Union Pacific Railroad	0-3 YR	GIS Map	IOC, VOC, SOC, Microbials

² TOT = time-of-travel (in years) for a potential contaminant to reach the wellhead

³ IOC = inorganic chemical, SOC = synthetic organic chemical, VOC = volatile organic chemical